
25X1 CHINA HSI-AN HVY ELEC EQPMT PLT 34 16 N 109 02 E 220kv condenser-meter transformer. Trial produced 1964. 1965.

Confidential (23) CIA 1082436





ILLEGIB

ILLEGIB

Approved For Release 2003/12/19: CIA-RDP78-04546A003100070005-8

Machine Industry

This photo shows workers at the Sian Electrical Condenser Plant in Shensi Province assemblying the newly-manufactured 220kv condenser-type meter / transformer. Used for measuring and protecting high-tension lines, the transformer of this type hitherto has been imported from foreign countries. After more than a year of research and experiments, the technicians and the workers at this plant succeeded in the trial-manufacturing of this transformer in 1964.


15 Oct 65, No 54

25X1 CHINA TA-LIEN ELEC MACH PLT 38 54 N 121 35 E Elec motors assembly line. 1965. Confidential (23,25) CIA 1082437

25X

Approved For Release 2003/12/19 : CIA-RDP78-04546A003100070005-8

		_	$\overline{}$	ı	_
1	1	⊢	(-	ı	Н

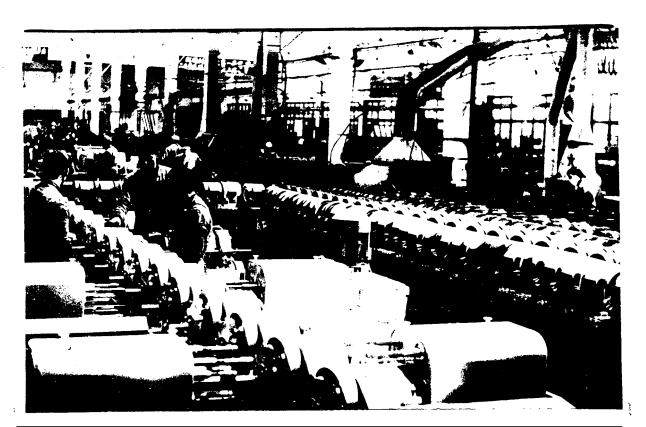

ILLEGIB

ILLEGIB

Approved For Release 2003/12/19: CIA-RDP78-04546A003100070005-8

Approved For Release 2003/12/46

Machine Industry

This year, two automation lines began operation at the Dairen (Ta-lien) Electrical Machinery Plant. The photo shows one of them, the automatic assembly line for electric motors. After the completion of the two lines, the workers' work-load was greatly reduced and the assemblying efficiency was increased by more than twofold.

15 Oct 65, No 54


Approved Før Release 2003/12/19: CIA-RDP78-04546A003100070005-8

CHINA WAC 382B PAO-TING 38 52 N 115 29 E
Pao-ting Transformer Plt storage room. 1965.
Confidential (23)

CIA 1082438

1				\sim	ī	г
ı	IL	L	ᆮ	U	ı	Е



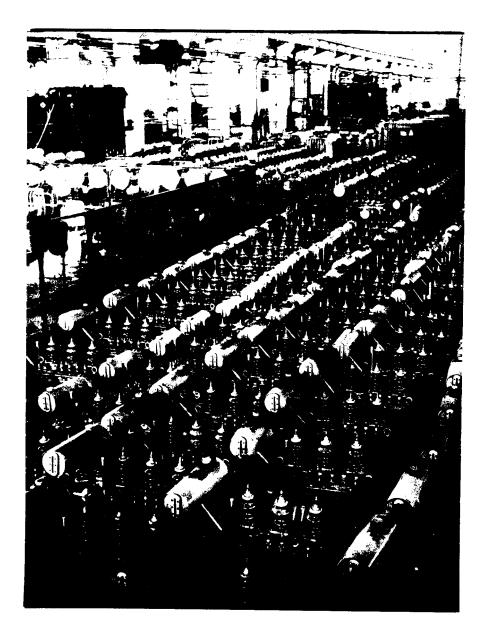

ILLEGIB

ILLEGIB

Approved For Release 2003/12/19 : CIA-RDP78-04546A003100070005-8_

Approved For Release 2003/12/19: CIA-RDP78-04546A003100071000518dustry This photo shows transformers for agricultural-use awaiting shipment at the Pao-ting Transformer Plant in Hopeh Province. 15 Oct 65, No 54